




NRS GATE VALVE MJ X FL

MODEL LVPIVFLMJ



GENERAL SPECIFICATIONS:

- Valves comply with AWWA C515-15 standard
- Non-rising stem, resilient seated (EDPM encapsulated wedge)
- Triple O-Ring seal
- Available with optional test plug on valve body (special order)
- Post indicator valves provided with universal "Indicator Post Plate"
- Mechanical joint ends to AWWA C153/A21.53 standard
- Available open right, please specify
- Flanged ends to ANSI B16.1, Class 125
- UL Listed/FM Approved at 300 PSI water working pressure rating
- NSF-61 and NSF-372 Certified as lead-free for use in drinking water systems
- Temperature range: 33° F to 170° F
- Fusion bonded epoxy coated interior and exterior to AWWA C550 standard
- Flanged valves available with handwheel or operating nut

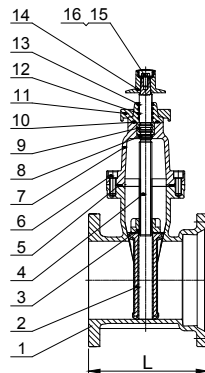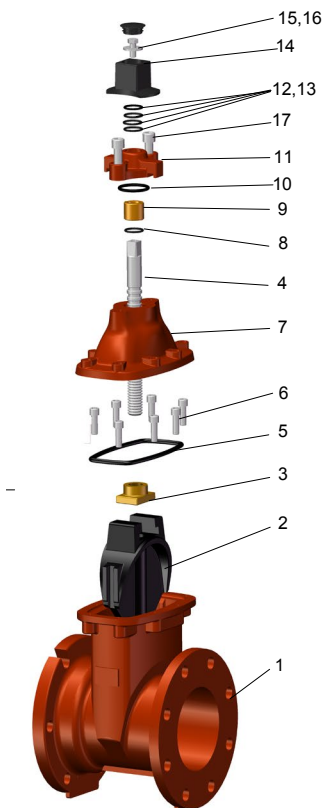

DIMENSIONS (In.)						
SIZE	3	4	6	8	10	12
L	8.75	9.5	11	12	13.9	14.5
H	11.7	12.7	16.9	20.9	24.7	28.1

NO.	PART NAME	MATERIAL	ASTM. SPEC.
1	Body	Ductile Iron	A536 Grade 65-45-12
2	Disc	Ductile Iron	EPDM Encapsulated
3	Wedge Nut	Bronze	B148 C95200
4	Stem	Stainless Steel	A276 Type 304SS
5	Gasket	Rubber	D2000, EPDM
6	Bolt	Stainless Steel	F593 Grade 304SS
7	Bonnet	Ductile Iron	A536 65-45-12
8	O-Ring	Rubber	D2000, NBR
9	Thrust Collar	Bronze	B148 C95200
10	O-Ring	Rubber	D2000, NBR
11	Gland	Ductile Iron	A536 Grade 65-45-12
12	O-Ring	Rubber	D2000, NBR
13	Dust Ring	Rubber	D2000, NBR
14	Operating Nut	Ductile Iron	A536 Grade 65-45-12
15	Bolt	Stainless Steel	F593 Grade 304SS
16	Washer	Stainless Steel	F276 Grade 304SS

PROJECT		APPROVAL STAMP
PROJECT:		<input type="checkbox"/> APPROVED
ADDRESS:		<input type="checkbox"/> APPROVED AS NOTED
ENGINEER:		<input type="checkbox"/> NOT APPROVED
SUBMITTAL DATA:		REMARKS:
NOTES 1:		
NOTES 2:		