



Model 375A

Reduced Pressure Principle Assembly

Application

Designed for installation on potable water lines to protect against both backsiphonage and backpressure of contaminated water into the potable water supply. The Model 375A provides protection where a potential health hazard exists. Ideal for use where Lead-Free* valves are required.

Standards Compliance

- ASSE® Listed 1013
 - AWWA Compliant C511 (with gates only), and C550
 - cUPC® Listed
 - CSA® Certified B64.4
 - UL® Classified
 - C-UL® Classified
 - FM® Approved
 - Approved by the Foundation for Cross Connection Control and Hydraulic Research at the University of Southern California.
 - NYC MEA 484-04-M
 - Meets the requirements of NSF/ANSI/CAN 61*
- *(0.25% MAX. WEIGHTED AVERAGE LEAD CONTENT)


Materials

Main valve body	Ductile Iron ASTM A 536
Access covers	Ductile Iron ASTM A 536
Coatings	NSF Approved electrostatic epoxy
finish Internals	Stainless Steel, 300 Series NORYL™
Fasteners & Springs	Stainless Steel, 300 Series
Seal rings	EPDM (FDA approved)
O-rings	Buna Nitrile (FDA approved)
Sensing line	Stainless Steel, braided hose

Features

Sizes:	2 1/2", 3", 4", 6", 8", 10"
Maximum working water pressure	175 PSI
Maximum working water temperature	140°F
Hydrostatic test pressure	350 PSI
End connections (Grooved for steel pipe)	AWWA C606
(Flanged)	ANSI B16.42
	Class 150

*2 1/2 & 3" sizes use 4" body & reducer couplings



(with NRS gates)



NSF/ANSI/CAN 61

Options (Suffixes can be combined)

- ☐ - with flanged end NRS gate valves (standard)
- ☐ FSC - with epoxy coated wye type strainer (flanged only)
- ☐ G - with grooved end NRS gate valves
- ☐ GF - with grooved inlet gate connection and flanged outlet gate connection
- ☐ FG - with flanged inlet gate connection and grooved outlet gate connection
- ☐ L - less shut-off valves (grooved body connections)
- ☐ OSY - with flanged end OS&Y gate valves
- ☐ OSYG - with grooved end OS&Y gate valves
- ☐ PI - with Post Indicator gate valve
- ☐ BG - with grooved end butterfly valves with integral supervisory switches
- ☐ BF - with flanged end butterfly valves with integral supervisory switches

*New Connected Products. Search [ZCSM-PF on Zurn.com](https://www.zurn.com/ZCSM-PF) for details.


Accessories

- ☐ Connected Pressure Monitor (Model ZCSM-PF)*
- ☐ Connected Flow Meter Option (Model ZCSM-BTM must be ordered with Model ZCSM-PF)*
- ☐ Repair kit (rubber only)
- ☐ Thermal expansion tank (Model XT)
- ☐ OS & Y Gate valve tamper switch (OSY-40)
- ☐ Air gap (Model AG)
- ☐ QT-SET Quick Test Fitting Set
- ☐ Wireless Monitor Retrofit Kit for conversion of existing model 375 (212-6-RFK-375W1, 8-10-RFK-375W1)


Dimensions & Weights (do not include pkg.)

MODEL 375A SIZE	WEIGHT															
	WITHOUT GATES		WITH NRS GATES (GXF)		WITH OS&Y GATES (GXF)		WITH NRS GATES (GXG)		WITH OS&Y GATES (GXG)		WITH BUTTERFLY VALVES (GXG)		WITH BUTTERFLY VALVES (GXF)			
	in.	mm	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg
2 1/2	65	97	44	191	87	199	90	183	83	191	87	139	63	149	68	
3	80	96	43.5	211	96	217	98	201	91	207	94	141	64	154	70	
4	100	83	38	227	103	237	108	201	91	211	96	131	59	153	69	
6	150	136	62	356	162	372	169	326	148	342	155	210	95	240	109	
8	200	305	139	757	344	781	355	757	344	757	344	449	204	495	225	
10	250	358	162	985	447	1043	473	863	391	921	418	574	260	632	287	

MODEL
375A with OSY
& FSC option

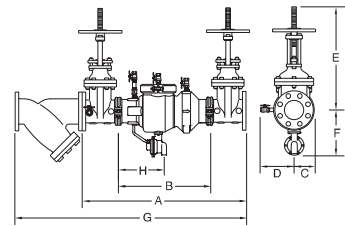

MODEL
375A with
BG option

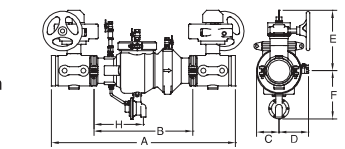

Relief Valve
discharge port:
2 1/2" - 6" - 2.75 sq. in.
8" - 10" - 3.69 sq. in.

Attention: Model 375A (grooved body) and Model 375 (flange body) have different lay lengths.

MODEL 375A SIZE	DIMENSION (approximate)																								
	A		A WITH BUTTERFLY VALVES		B LESS GATE VALVES		C		D		E OS&Y OPEN		E OS&Y CLOSED		E NRS GATE		E WITH BUTTERFLY VALVES		F		G		H		
	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	
2 1/2	65	35 1/8	892	32 1/8	816	20 1/8	511	4 1/2	114	7 1/4	184	16 3/8	416	13 7/8	352	11 3/8	289	8 1/4	210	11	279	45 1/4	1150	9 5/8	247
3	80	36 1/8	918	33	838	20 1/8	511	4 1/2	114	7 1/4	184	18 7/8	479	15 5/8	397	12 3/8	314	8 1/2	216	11	279	46 7/8	1191	9 5/8	247
4	100	38 1/4	972	33 1/4	845	19 7/8	505	4 1/2	114	8	203	22 3/4	578	18 1/4	464	14 3/4	375	9	229	11	279	53 3/8	1356	9 5/8	247
6	150	47 1/4	1200	40 1/4	1022	25 7/8	657	5 1/2	140	10	254	30 1/8	765	23 3/4	603	19	483	10 1/4	260	12 3/8	314	65 3/8	1661	13	330
8	200	62	1575	55	1397	38 1/2	978	10	254	11	279	37 3/4	959	29 1/4	743	22 1/2	572	12	305	15 3/8	391	86 3/8	2194	17 5/16	440
10	250	64 5/8	1641	59	1499	38 1/2	978	10	254	12	305	45 3/4	1162	35 3/8	899	26 1/2	673	13	330	15 3/8	391	94 3/8	2398	17 1/8	435

Zurn Industries, LLC | Wilkins

1747 Commerce Way, Paso Robles, CA U.S.A. 93446 Ph. 855-663-9876, Fax 805-238-5766

In Canada | Zurn Industries Limited

7900 Goreway Drive, Unit 10, Brampton, Ontario L6T 5W6, 877-892-5216

www.zurn.com


Rev. L

Date: 12/22

Document No. BF-375A


Product No. Model 375A

Patent zurn.com/patents

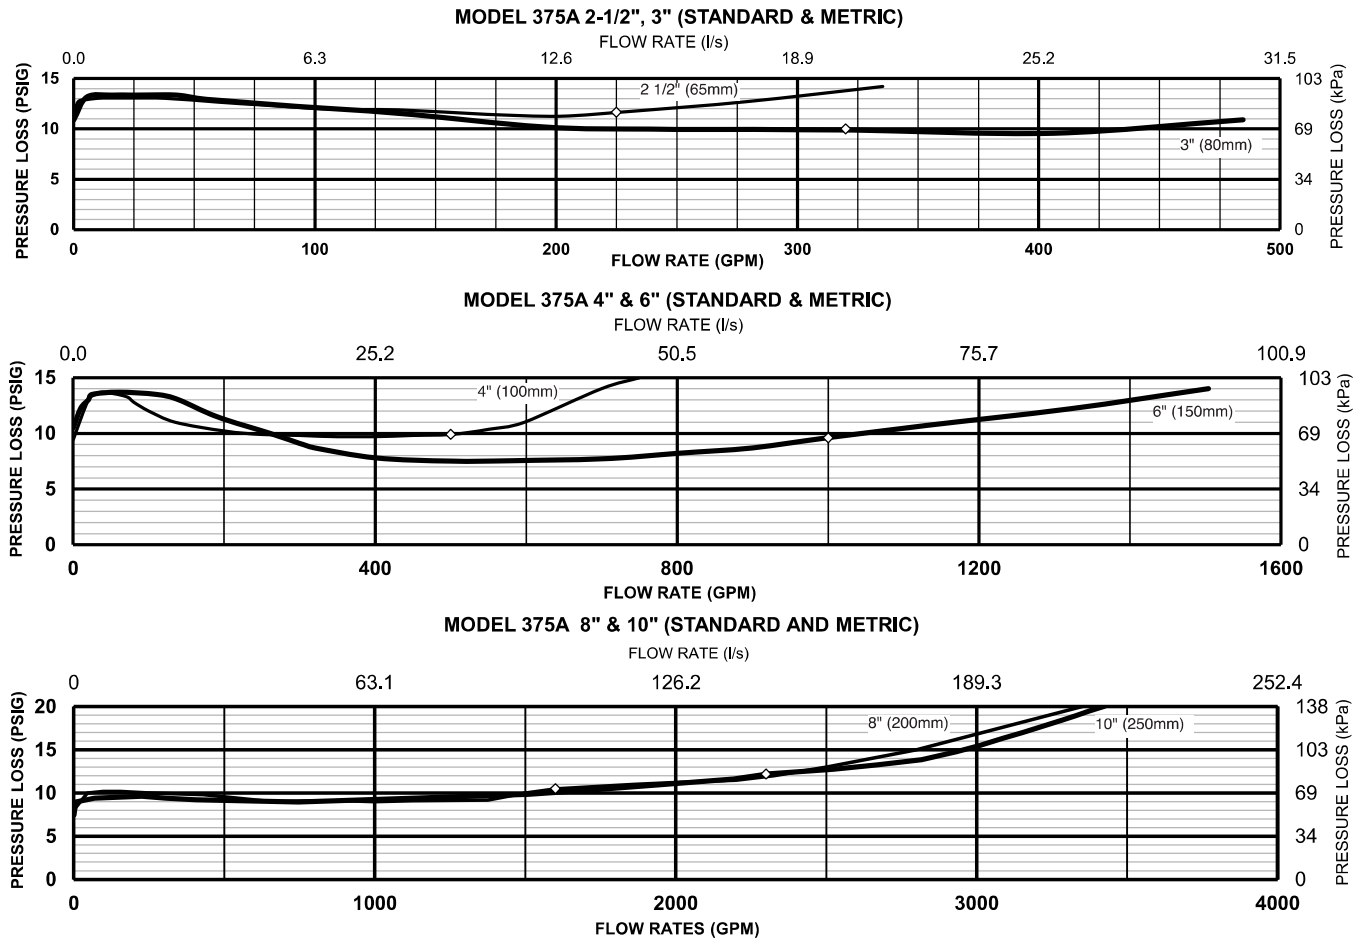

Typical Installation


Local codes shall govern installation requirements. Unless otherwise specified, the assembly shall be mounted at a minimum of 12" (305mm) and a maximum of 30" (762mm) above adequate drains with sufficient side clearance for testing and maintenance. The installation shall be made so that no part of the unit can be submerged.

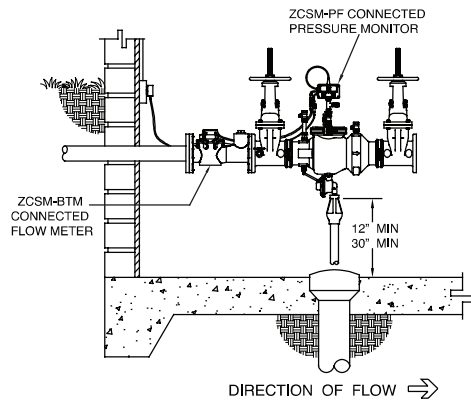

INDOOR INSTALLATION

(375AOSY with ZCSM-PF Connected Pressure Monitor and ZCSM-BTM Connected Flow Meter accessories)

Capacity thru Schedule 40 Pipe (GPM)				
Pipe size	5 ft/sec	7.5 ft/sec	10 ft/sec	15 ft/sec
2 1/2"	75	112	149	224
3"	115	173	230	346
4"	198	298	397	595
6"	450	675	900	1351
8"	780	1169	1559	2339
10"	1229	1843	2458	3687
12"	1763	2644	3525	5288

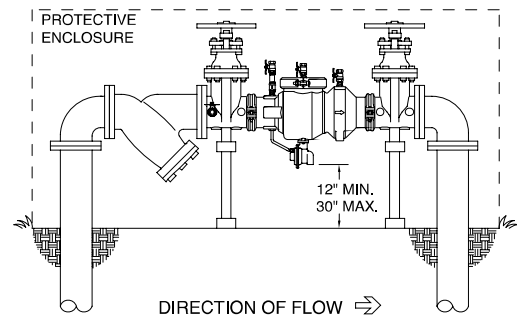

OUTDOOR INSTALLATION (375A with FSC option)

Specifications

The Reduced Pressure Principle Backflow Prevention Assembly shall be certified to NSF/ANSI/CAN 61, ASSE® Listed 1013, and supplied with full port gate valves. The main body and access cover shall be epoxy coated ductile iron (ASTM A 536), the seat ring and check valve shall be NORYL™, the stem shall be stainless steel (ASTM A 276) and the seat disc elastomers shall be EPDM. The checks and the relief valve shall be accessible for maintenance without removing the device from the line. The Reduced Pressure Principle Backflow Prevention Assembly shall be a ZURN WILKINS Model 375A.